Attention !

The relays used must be interlocked
Terminal 1 + 2 + 3 = power supply from relay
Terminal 9 + 10 = safety circuit
Terminal 11 + 12 = end position
Terminal 15 + 16 = end position
External pushbuttons must be wired between terminal 10 + 11 respectively 10 + 15
Terminal 4 = Earth wire connection / PE

F2 = Thermal switch inside motor winding
S4 = Safety limit switch for end position S6
S5 = Safety limit switch for end position S7
S6 = limit switch
S7 = limit switch

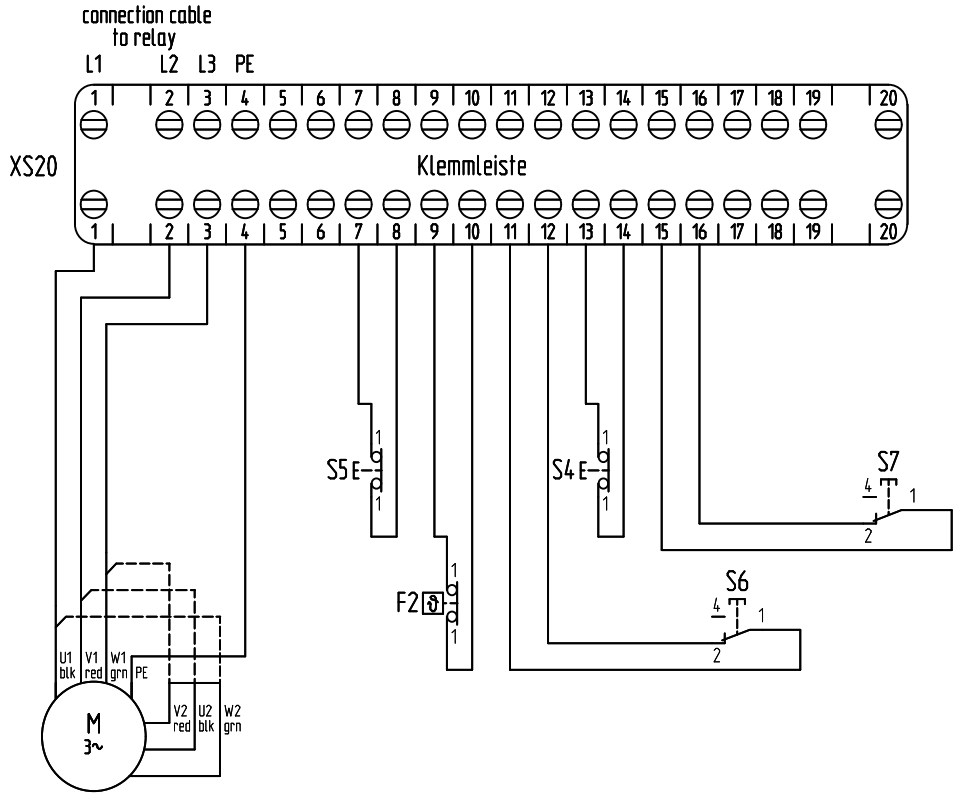

3-phase AC motor

△ 230 Volt [X]

Y 400 Volt [ ]

Voltage _____

Subject to technical changes

				Datum	27.04.2017	Framo Morat GmbH & Co. KG Höchst 7 D-79871 Eisenbach www.framo-morat.com		Version 2 6-12-MS-LT03	Projekt: Compacta		P-No.	=cs2167				
				Bearb.	abe / bho						V-No.	+				
				Gepr.	bho					Projekt Nr. 20000000					Blatt 1		
Zustand	Änderung	Datum	Name	Norm		Urspr.	Ers. f.	Ers. d.		Zeichnung: cs2000.zng					von	1 Bl.	